

Annexure C

Appendix-XIII

PROFORMA FOR SAGE DRINKING WATER AND SANITARY CONDITION CERTIFICATE


No. 3756

Dated : 20/05/2023

It is certified that an inspection team headed by Dr. Sudhansu Sekhar Bal, DPHO, Jaipur from Health and PW Department inspected the APEX ENGLISH MEDIUM SCHOOL, At-Laliteswar Nagar (Baidyarajpur), Jaipur on 20.05.2023 checked the water test report submitted by the school and found that the school has potable drinking water for students and staff of the institution and is having provision for running water in the toilets and maintaining hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.

The above is valid for a period of TWO Yrs

Signature with Seal :

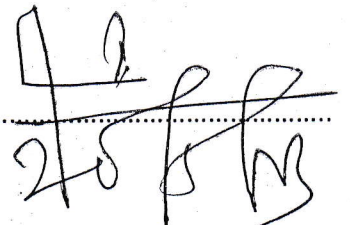

Name

: Dr. Sudhansu Sekhar Bal

Designation

: District Public Health Officer
District Public Health Officer
Jaipur

Name & Address of the Office / Department :

o/o - CDM & PHO, Jaipur
At/PO/out - Jaipur

To

Principal
Apex English Medium School
Laliteswar Nagar, Baidyarajpur, Jaipur
(Name & Address of the Institution)


Chairman-cum-Director
Apex English Medium School
JAJPUR


PRINCIPAL
APEX ENGLISH MEDIUM SCHOOL
JAJPUR



Qualitek Labs
Delivering Business Confidence

QUALITEK LABS PVT. LTD.

D2/18, Mancheswar Industrial Estate, Bhubaneswar – 751010

<https://www.qualiteklab.com>

Customer Name : Mr. Anil Kumar Ray
Sampling Location : Apex English Medium School, Baidyarajpur, Devidwar, Jajpur – 755007
Sample Source : Bore Well
Sample Collection Date : 12-05-2023
Sample Receipt Date : 12-05-2023
Report Generation Date : 16-05-2023

Sl. No.	Parameters	Test Methods	Obtained Results	Limits (Max.)	
				Acceptable Limit	Permissible Limit
1	Colour, Hazen Units	IS : 3025 (Part-4):1983, RA-2014	13,234	5HU	15HU
2	Odour	IS : 3025 (Part-5):1983, RA-2012	Agreeable	Agreeable	Agreeable
3	Free Residual Chlorine	IS : 3025 (Part-26):1986, RA-2009	0	0.2mg/L	1mg/L
4	Ammonia as N	IS : 3025 (Part-34), RA-2009	0.011	0.5mg/L	No Relaxation
5	pH	IS : 3025 (Part-11):1983, RA-2006	6.82	6.5 – 8.5	No Relaxation
6	Taste	IS : 3025 (Part-7 & 8):1984, RA-2012	Agreeable	Agreeable	Agreeable
7	Turbidity	IS : 3025 (Part-10):1984, RA-2012	0.21	1NTU	5NTU
8	Conductivity	IS : 3025 (Part-14):1984, RA-2002	33.8	NA	NA
9	Total Dissolved Solids	IS : 3025 (Part-16):1984, RA-2006	16	500mg/L	2000mg/L
10	Total Suspended Solids	IS : 3025 (Part-17):1984, RA-2012	0	10mg/L	50mg/L
11	Dissolve Oxygen	IS : 3025 (Part-38), RA-2003	6.8	NA	NA
12	Total Alkalinity (as CaCO ₃)	IS : 3025 (Part-23):1986, RA-2003	14	200mg/L	600mg/L
13	Total Hardness (as CaCO ₃)	IS : 3025 (Part-21), RA-2009	20	200mg/L	600mg/L
14	Calcium (as Ca)	IS : 3025 (Part-40), RA-2009	4.003	75mg/L	200mg/L
15	Magnesium (as Mg)	IS : 3025 (Part-46), RA-2001	2.430	30mg/L	100mg/L
16	Chlorides (as Cl)	IS : 3025 (Part-32):1988, RA-2003	1.000	250mg/L	1000mg/L
17	Fluoride (as F)	APHA 22 nd Edition 4500 F – (D)	0.049	1.0mg/L	1.5mg/L
18	Iron (as Fe)	IS : 3025 (Part-53):2003 (CL6)	0.021	1.0mg/L	No Relaxation
19	Sulphate	IS : 3025 (Part-24):1986, RA-2009	2.356	200mg/L	400mg/L
20	Sulphide (H ₂ S)	IS : 3025 (Part-29):1986, RA-2009	0.008	0.05mg/L	No Relaxation
21	Nitrate (as NO ₃)	APHA 22 nd Edition 4500 N – (B)	1.009	45mg/L	No Relaxation
22	Nitrite (as NO ₂)	IS : 3025 (Part-34), RA-2009	0.003	NA	NA
23	Sodium	IS : 3025 (Part-45):1994, RA-2014	3.9	NA	NA
24	Potassium	IS : 3025 (Part-45):1994, RA-2014	0.6	NA	NA
25	Phosphate (Total)	APHA 22 nd Edition 4500 P – (D)	0.019	0.5mg/L	5.0mg/L
26	Silica	IS : 3025 (Part-35):1988, RA-2014	1.258	NA	NA
27	Coliform CFU/100ml	IS 15185:2016	Absent	NA	NA
28	E.Coli CFU/100ml	IS 15185:2016	Absent	NA	NA
29	F. Streptococci CFU/100ml	IS 15185:2016	Absent	NA	NA

[Signature]
Signature (Analyst)

[Signature] Chairman-cum-Director
[Signature] Lab-in-Charge
PRINCIPAL
APEX ENGLISH MEDIUM SCHOOL
 Mancheswar, BBSR-10

Report Issue No. : 136/2023
 Report Issue Date : 17-05-2023